


CONSTRUCCIÓN DEL SISTEMA DE AGUA POTABLE: TANQUE ELEVADO

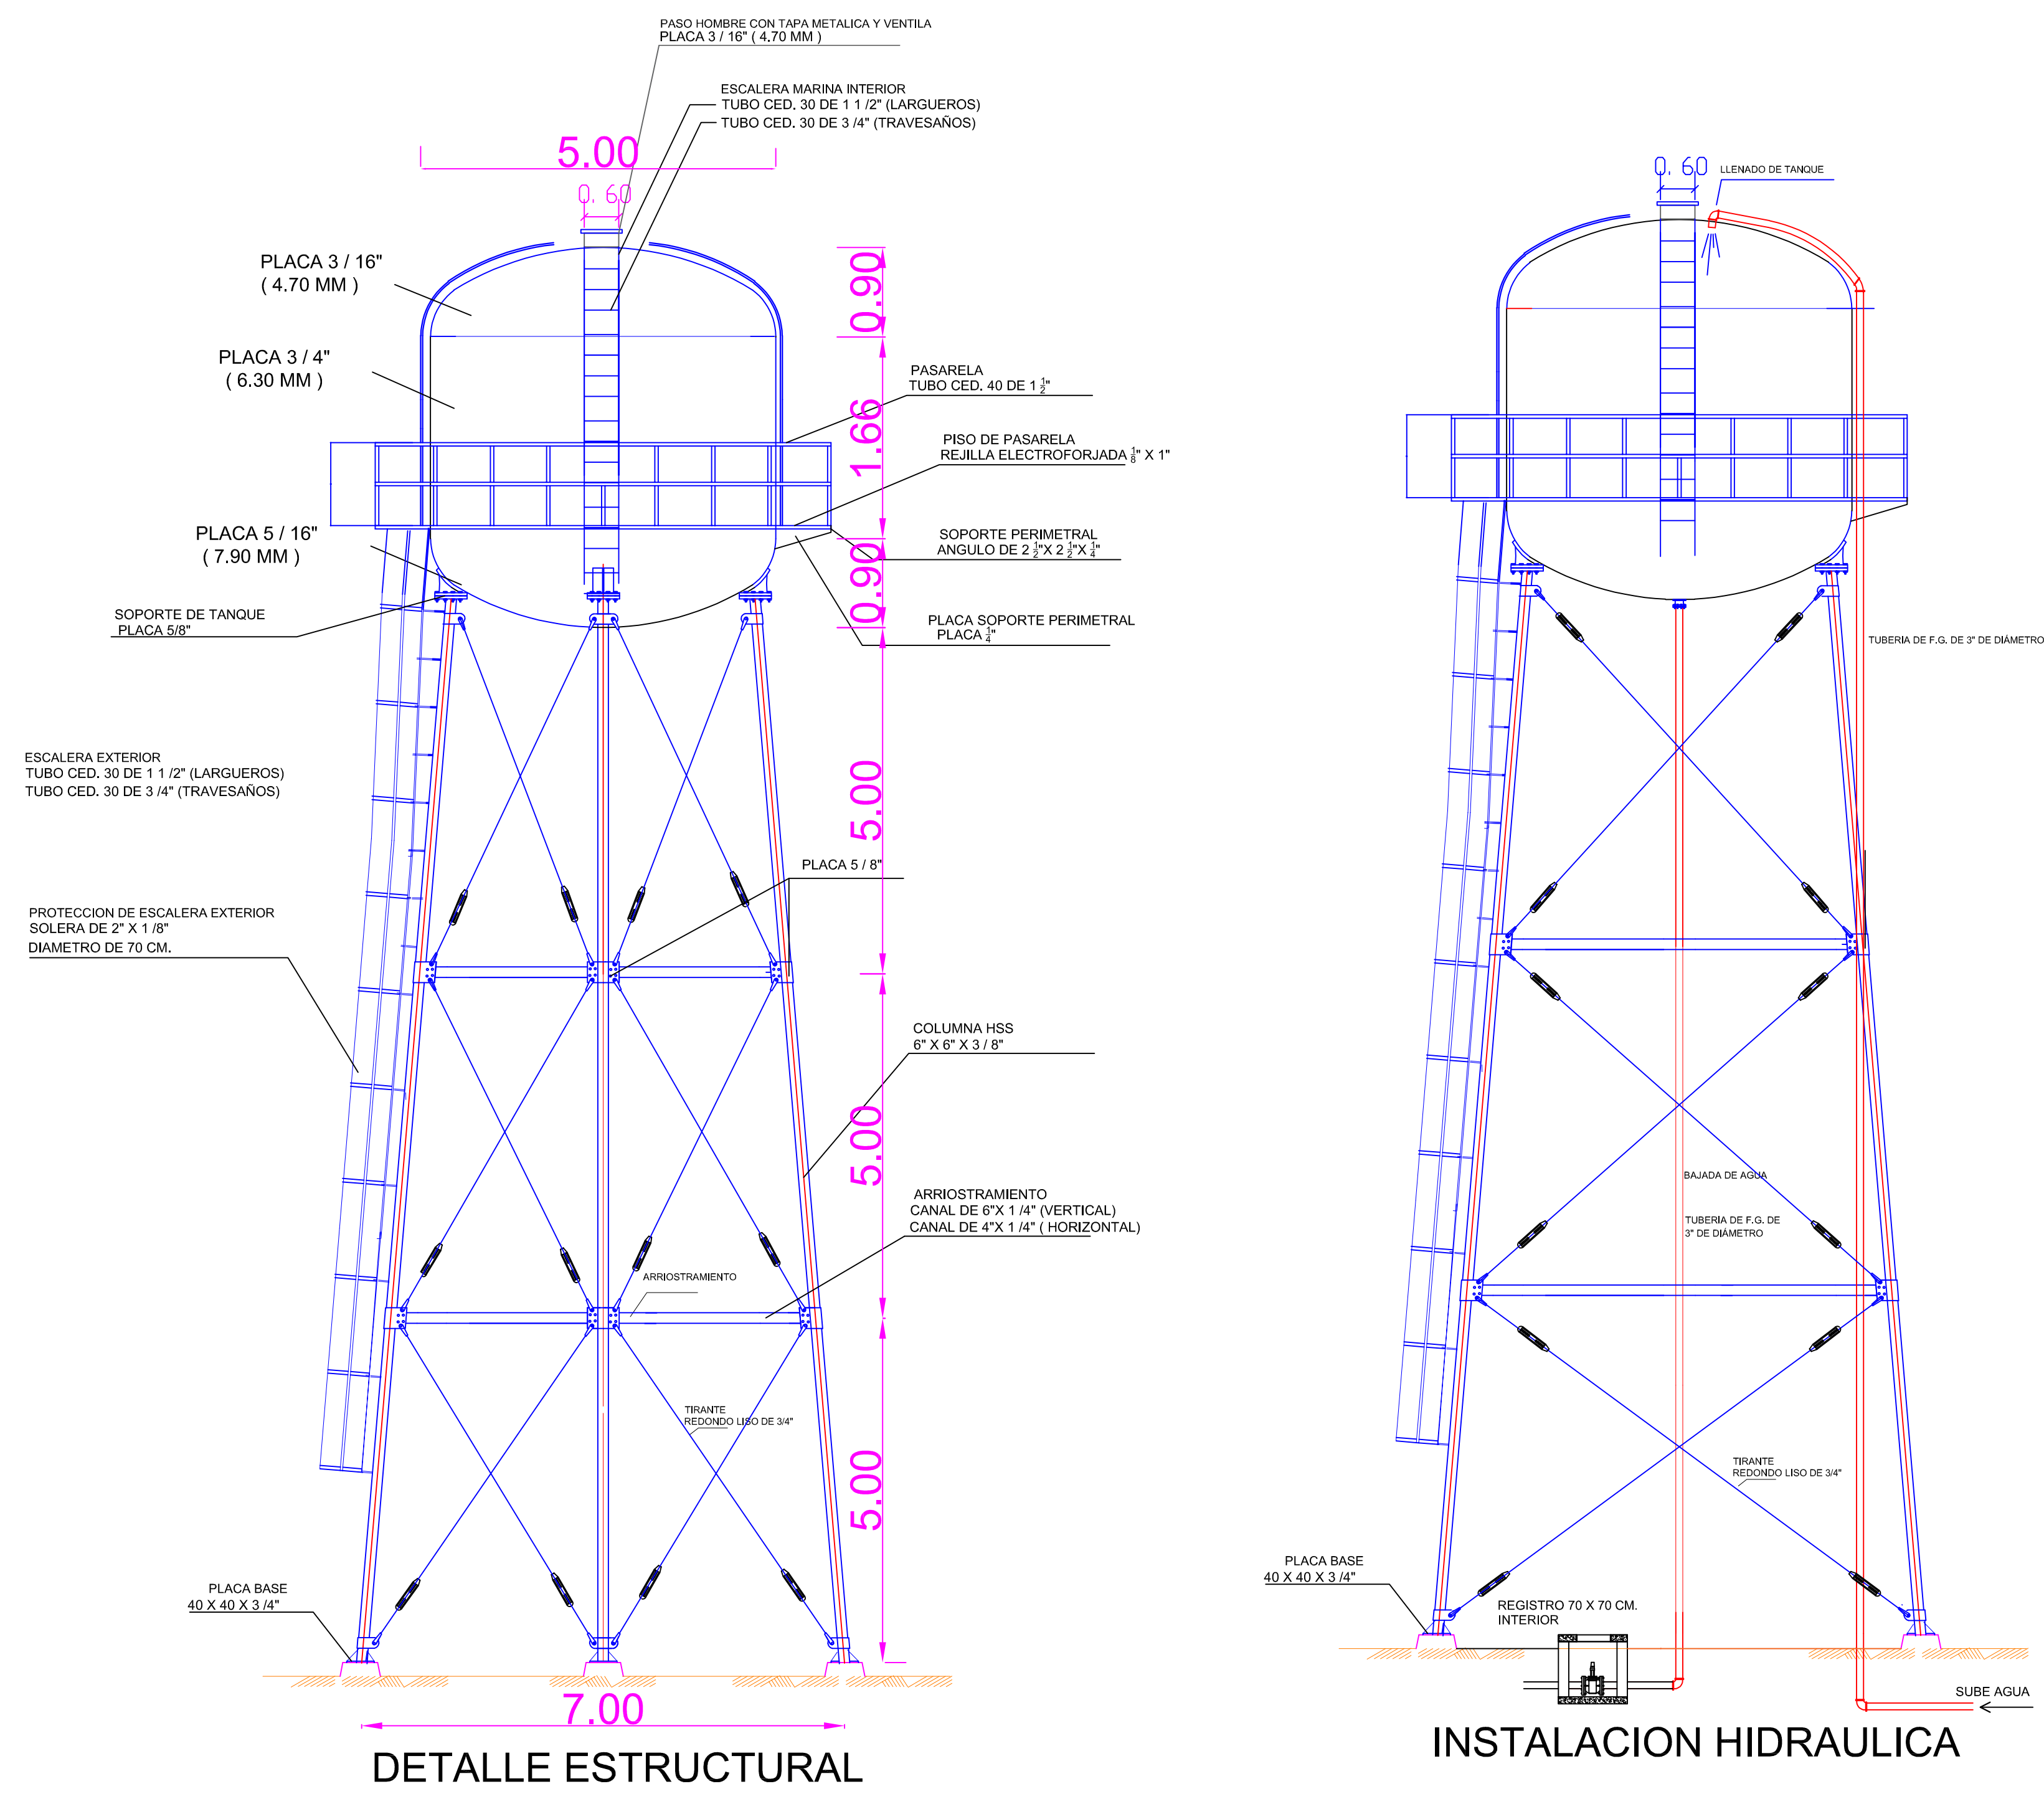

ESPECIFICACIONES GENERALES

CAPACIDAD	PESO APROXIMADO	ESPESOR LÁMINA DEL TANQUE		TUBO DE BAJADA
		lateral	fondo	
15	5.7	4.76	4.76	75
30	7.0	6.30	7.90	100
50	8.6	6.30	7.90	100
100	12.1	6.30	7.90	152

DIMENSIONES PRINCIPALES EN m.

CAPACIDAD m ³	a	b	c	d	e	f	h
15	3.00	1.85	0.85	0.85	2.30	0.38	15.00
30	3.50	2.05	0.90	0.90	1.40	0.38	15.00
50	5.00	1.66	0.90	0.90	1.56	0.43	15.00
100	5.38	2.61	1.50	1.50	1.58	0.64	15.00

